


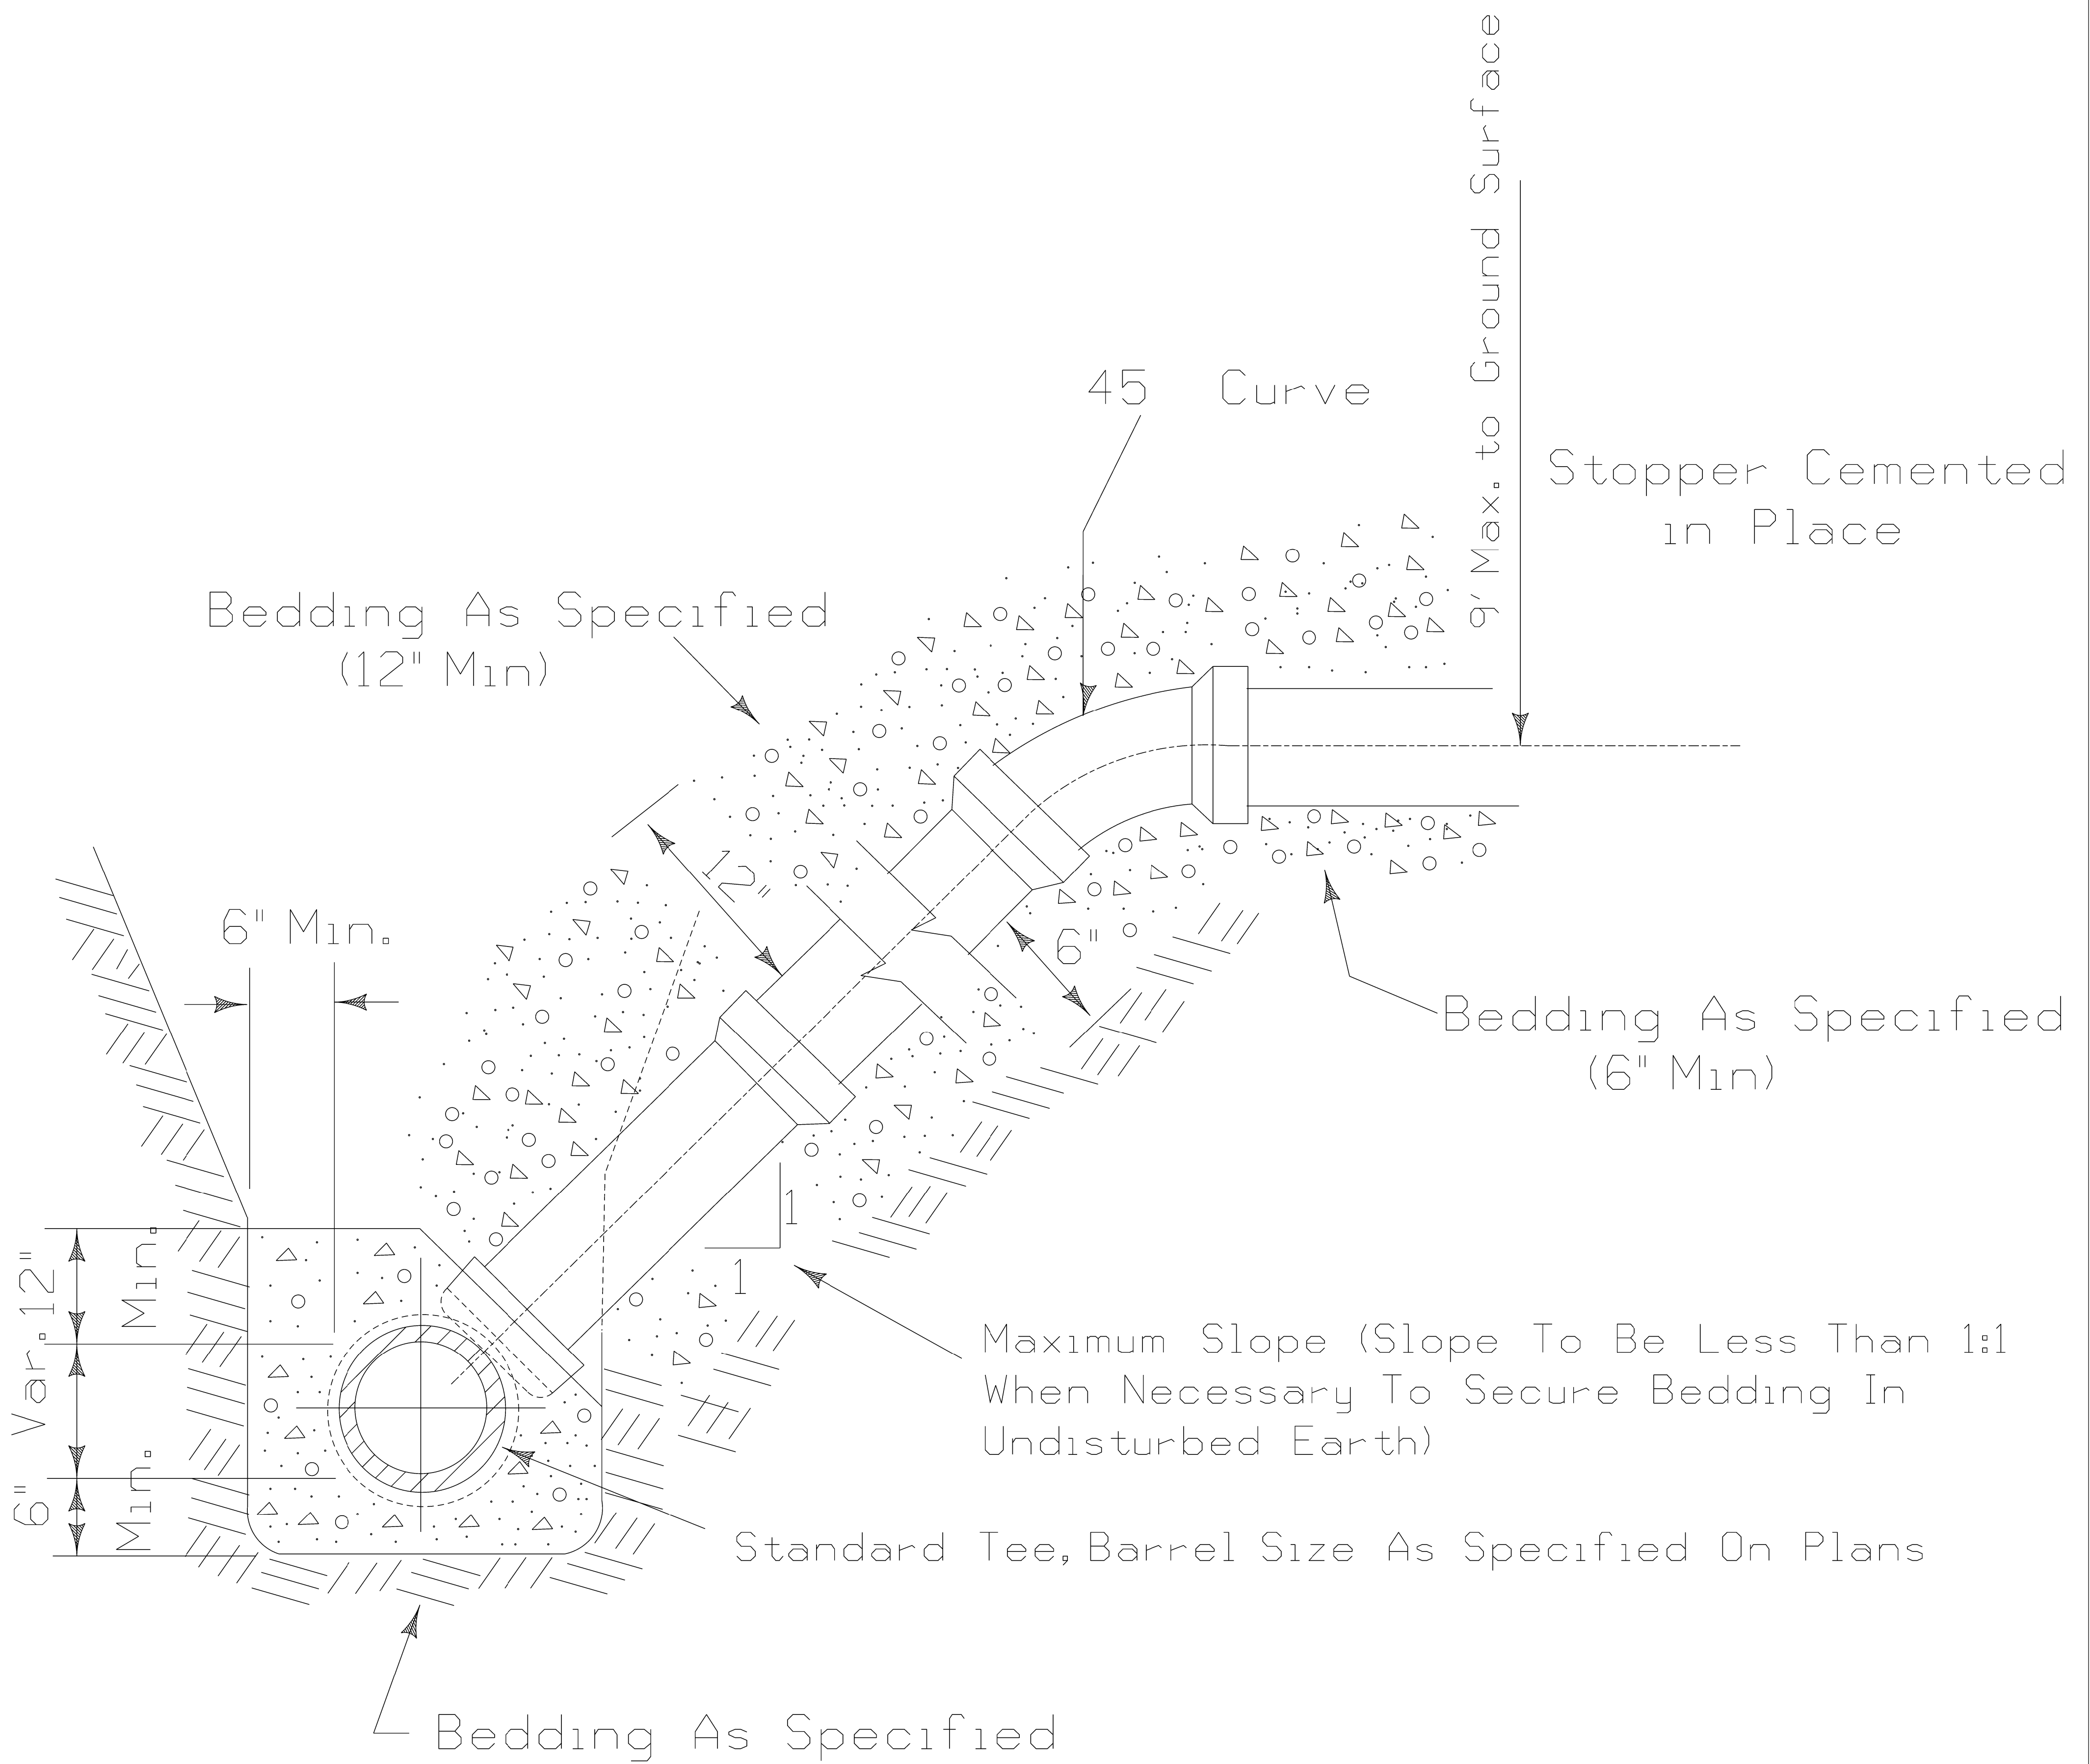

Note : Sanitary Connection on Existing Mains shall be CASCADE "CSWRT-0863-06RC" ASTM A 240, ASTM A 536, ASRM D 2000 MBA 710, OR Approved by the Village Engineer

SEWER SERVICE INSTALLATION

Issued by: DLZ		10/11/00
By	Revised	Date
SD		1/4/06
MJ		6/24/14
DS		1/26/23
DS		10/28/25

VILLAGE OF GURNEE
ENGINEERING DIVISION

Approved by:	
SD	1/4/06
SD	6/24/14
NL	1/26/23
NL	10/31/25