


(Max.) Trench Widths - 9" + O.D. + 9", When trench is Less than 5' Deep
 - 18" + O.D. + 18", When trench is Greater Than 5' Deep

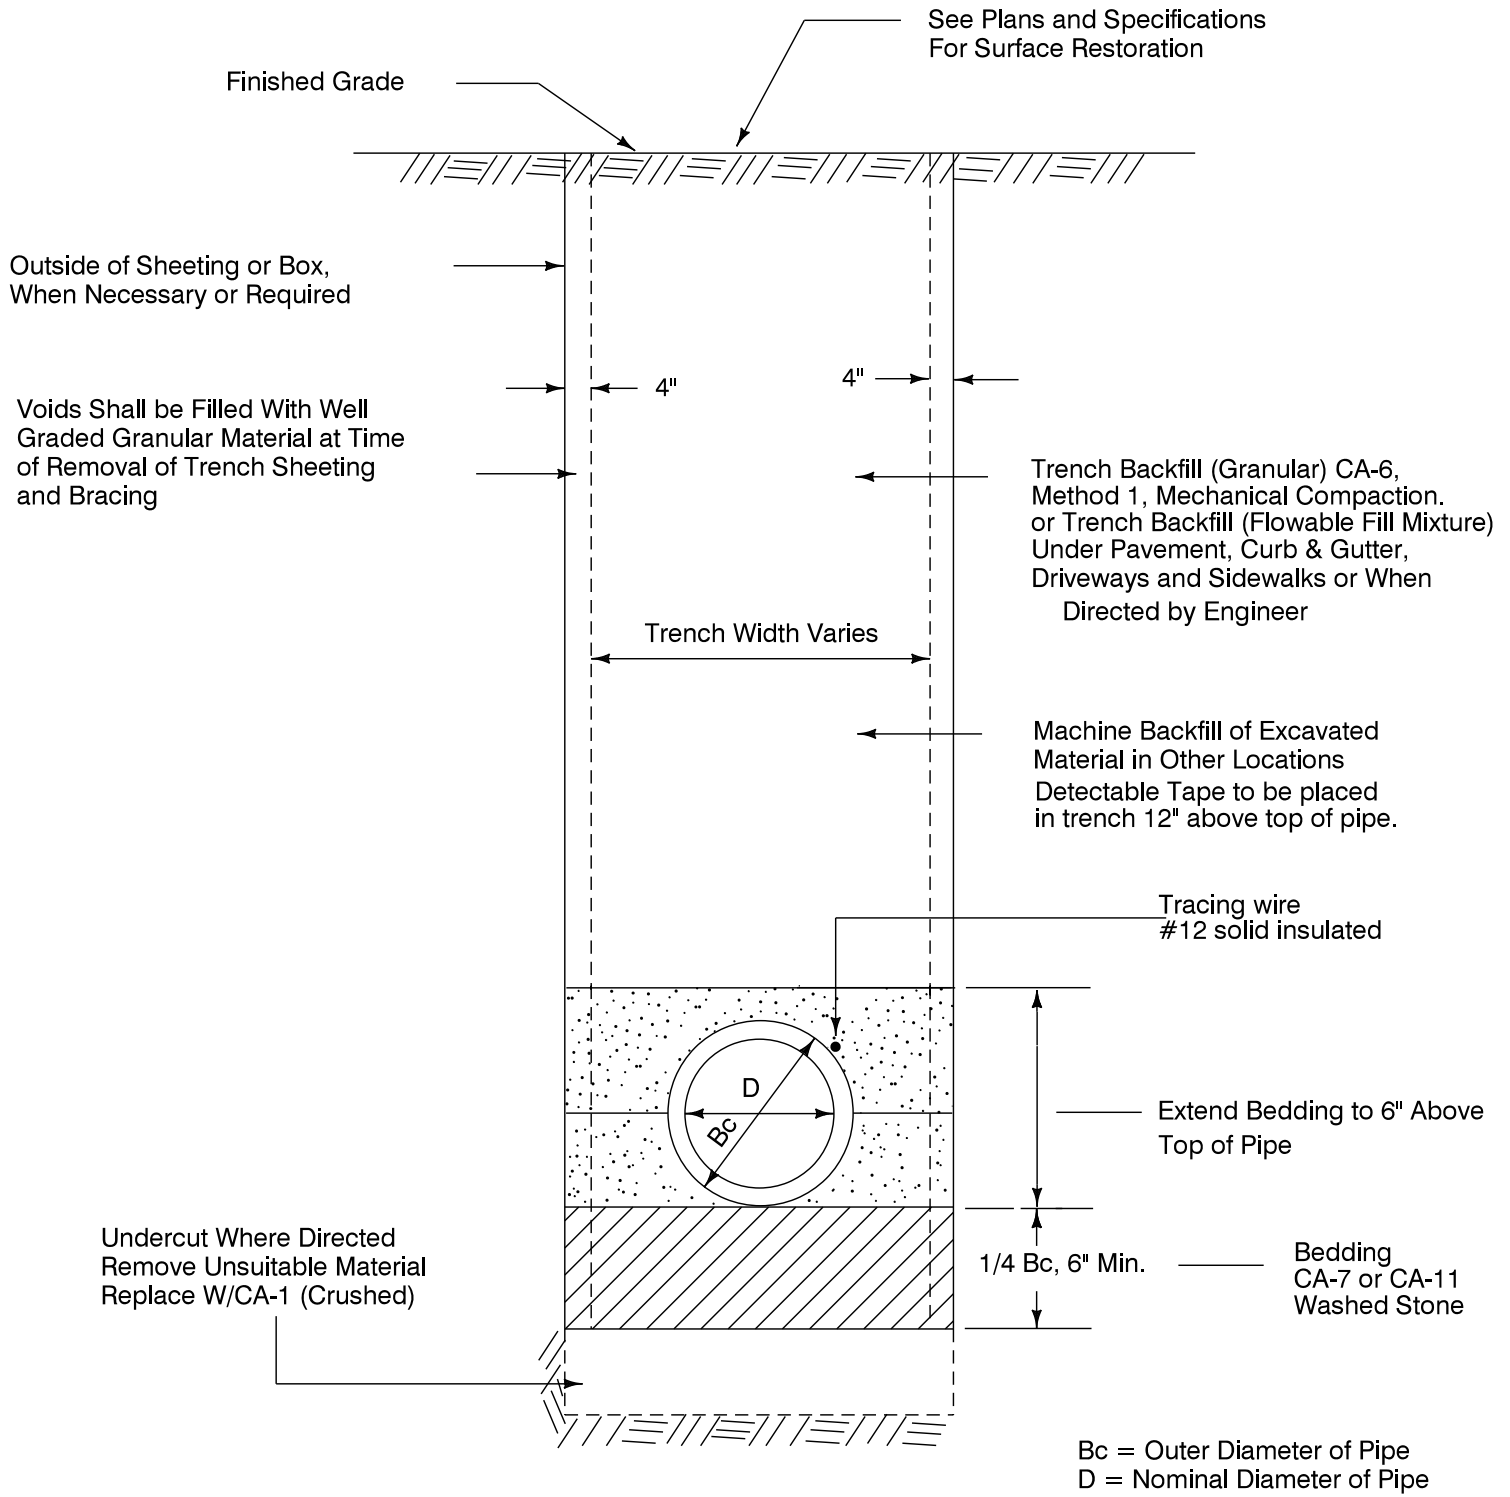

TYPICAL TRENCH AND BEDDING DETAIL WATER MAIN INSTALLATION

Issued		
By	Revised	Date
DPD		3-17-03
MAD		7-28-11
MJ		6-25-14

**VILLAGE OF GURNEE
 ENGINEERING DIVISION**

Approved by:	
SD	1/4/06
SD	7/29/11