


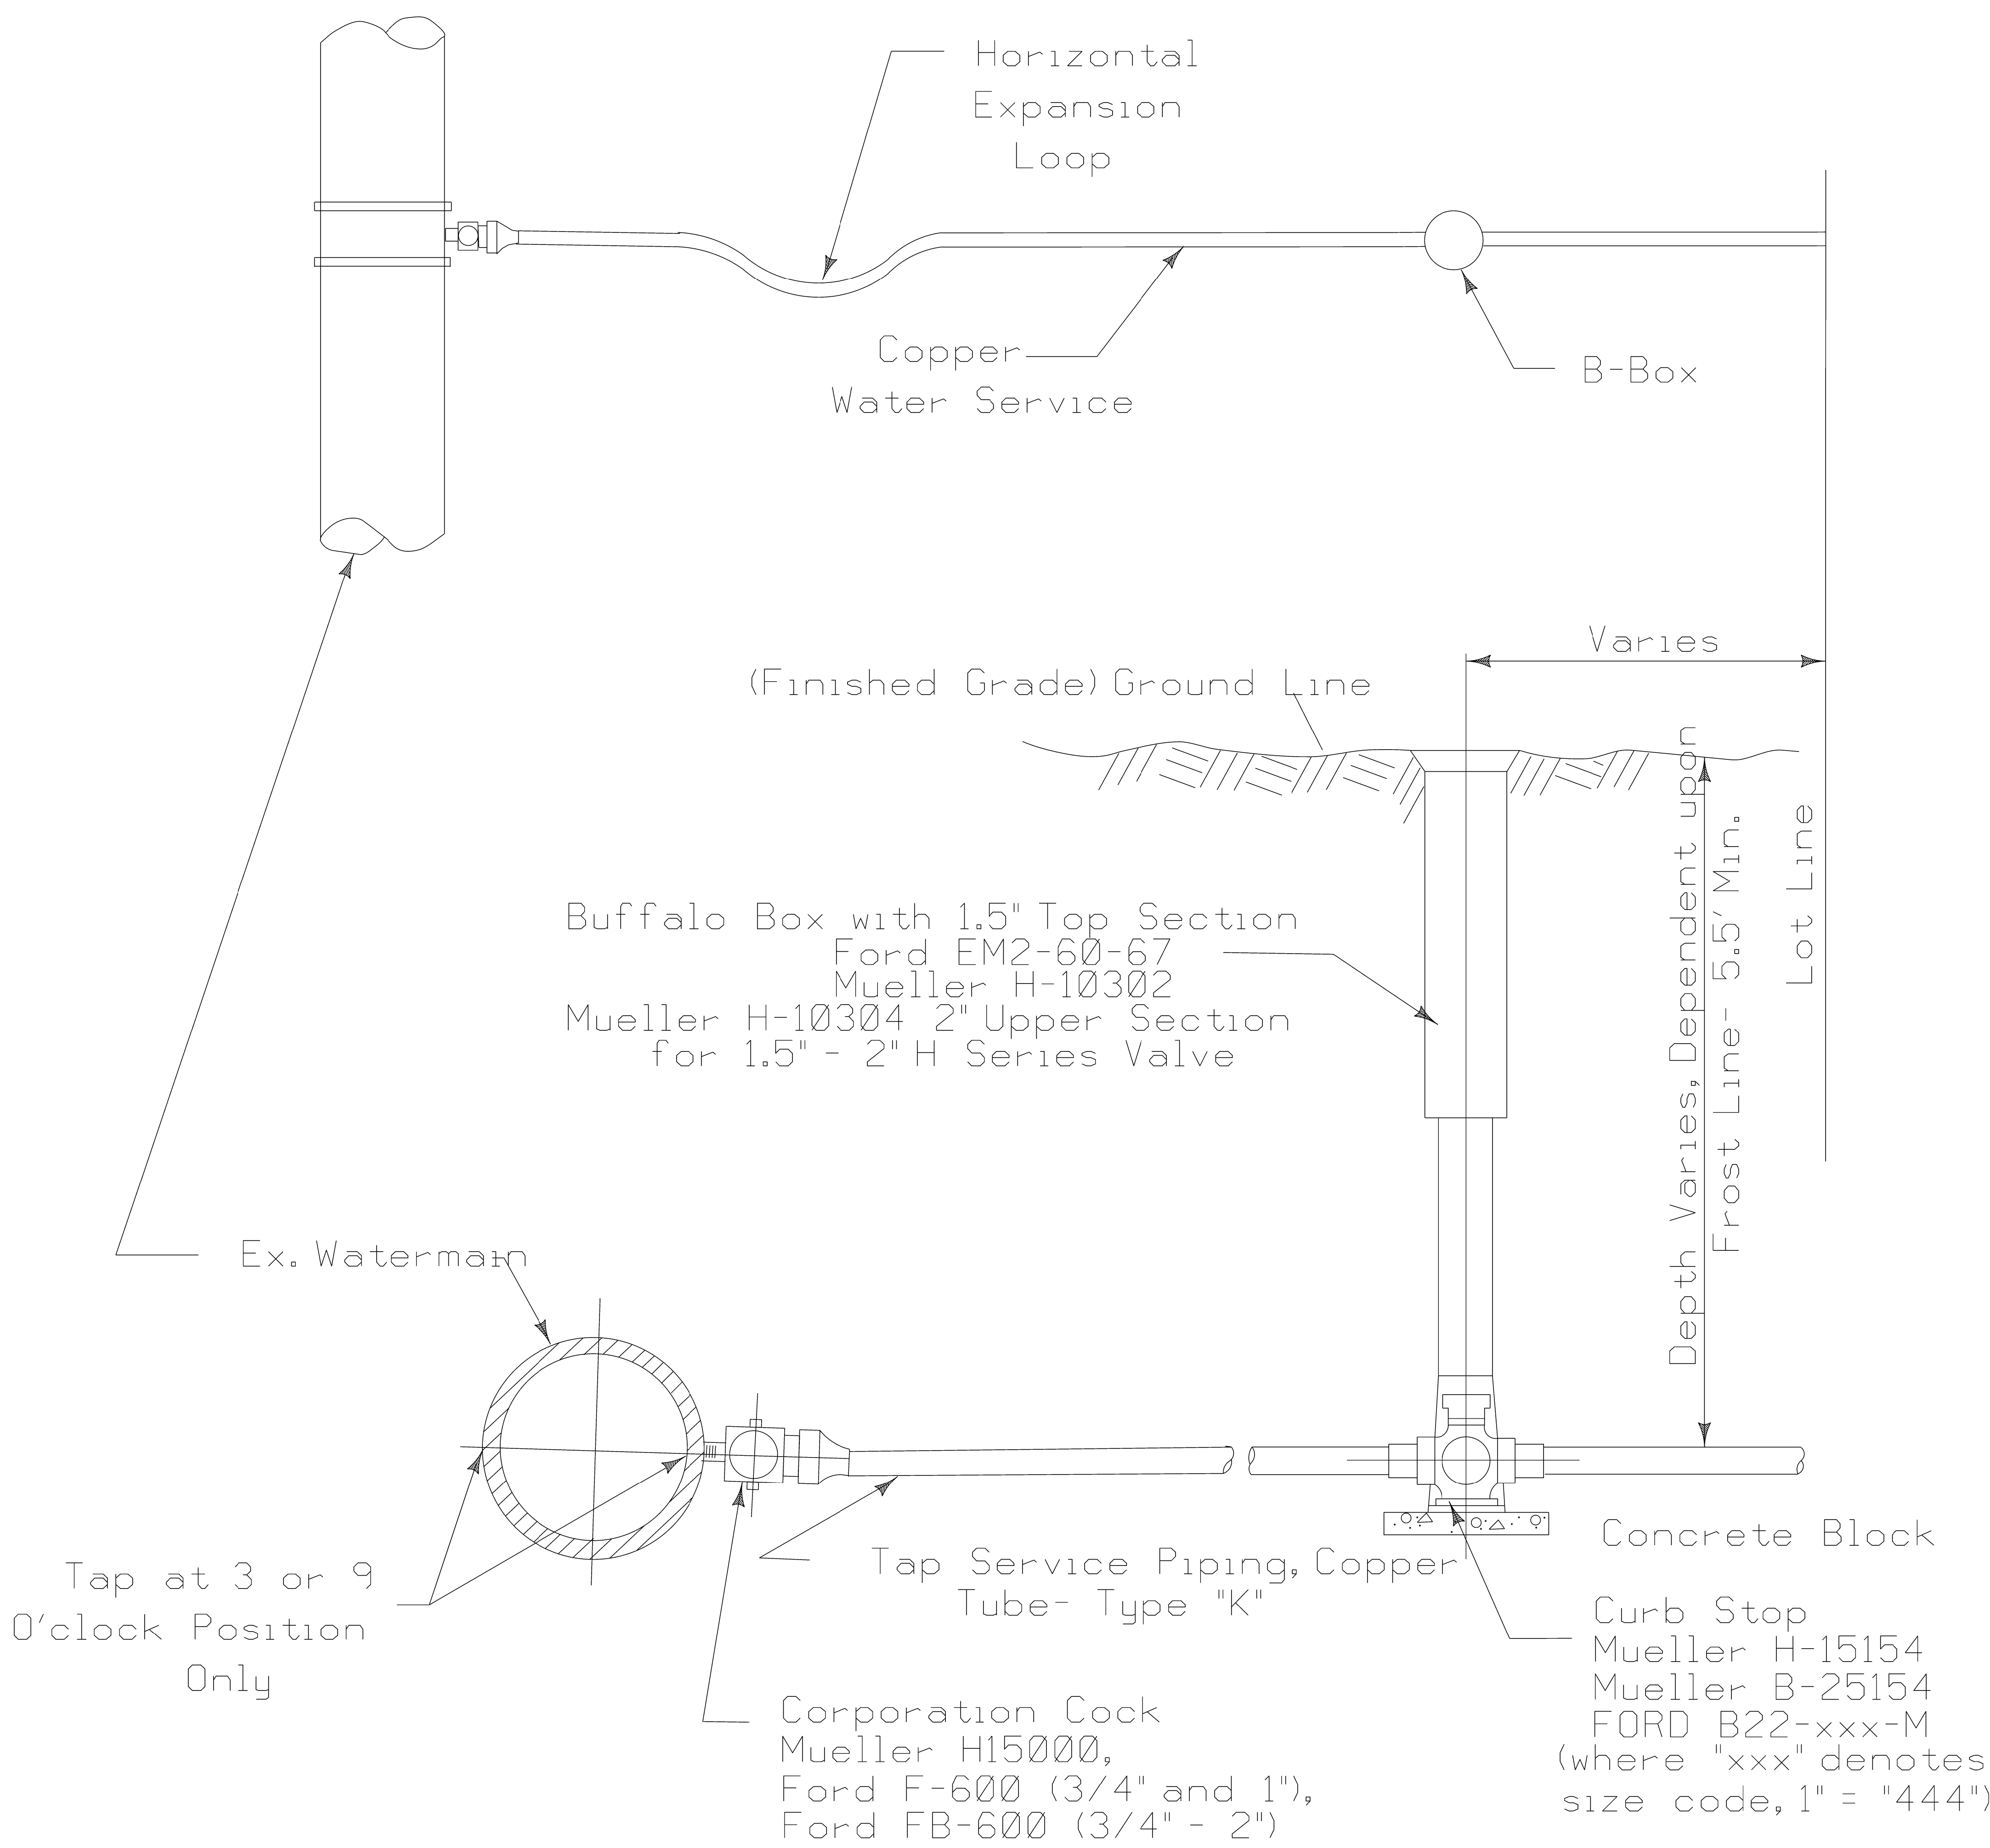

All Service Saddles Shall Be Double Strap; Bronze Nylon Coated or Stainless Steel Conforming to Village of Gurnee Standards
Sacrificial zinc anode nuts are to be installed on all bolts.

WATER SERVICE INSTALLATION

Issued by: DLZ 10/11/00		
By	Revised	Date
SD		1/4/06
MAD		7/28/11
MJ		6/25/14
DS		10/28/2025

VILLAGE OF GURNEE
ENGINEERING DIVISION

Approved by:	
SD	1/4/06
SD	7/29/11
SD	6/25/14
NL	10/31/25